

Chubb
POWERED BY API GROUP


- Carbon Dioxide
- Dry Chemical Powder
- Fire Sprinkler Control Valve
- First Aid Point
- Hydrant
- Manual Call Point
- Warden Intercommunication Point
- Exit
- Evacuation Path
- Assembly Area

Evacuation Procedures

IN CASE OF FIRE

- R** REMOVE people from immediate danger
- A** ALERT people nearby and raise an alarm (Call 000)
- C** CONFINE fire and smoke (Close doors behind you if safe to do)
- E** EVACUATE via the nearest emergency exit

Site Plan

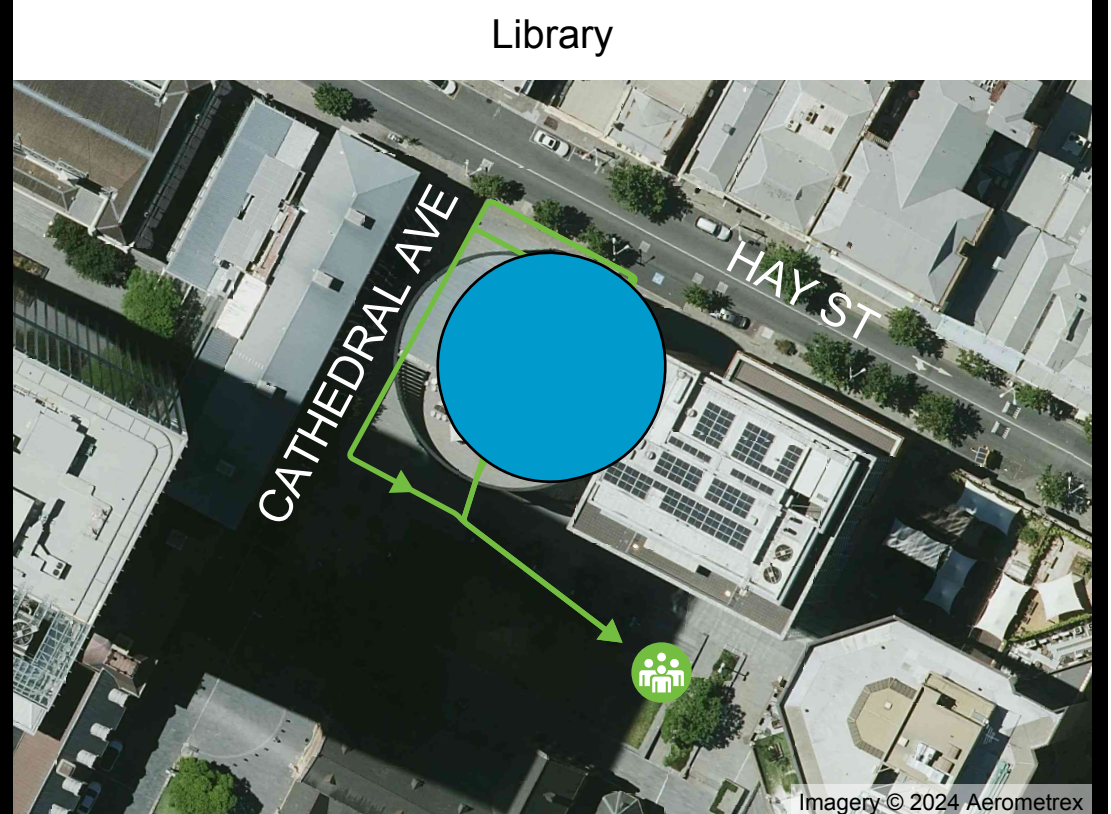

Imagery © 2024 Aerometrex